


**ELEVATION**

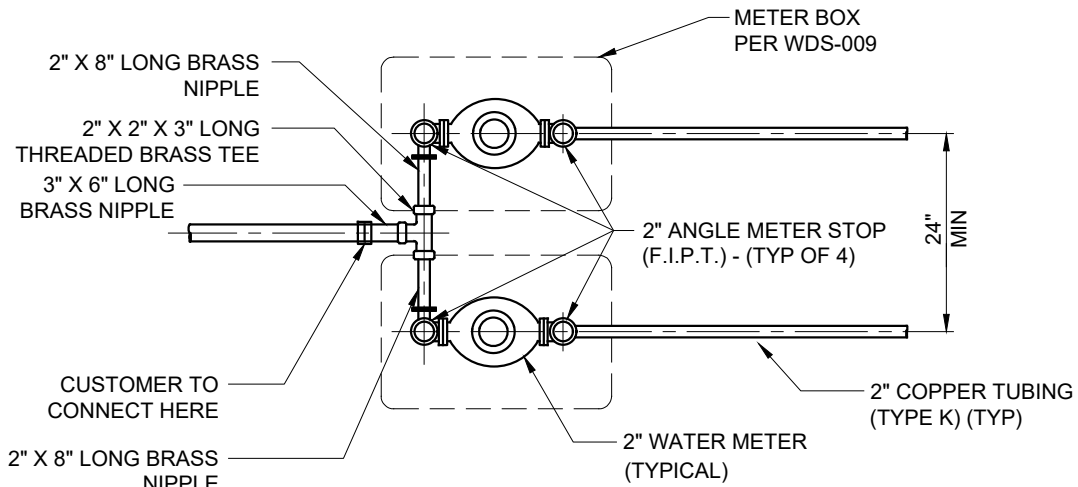

**PLAN**

**NOTES:**

1. SERVICE FITTINGS AND STOPS USED WITH COPPER TUBING SHALL BE BRASS AND "COMPRESSION" TYPE.
2. NO JOINTS ARE ALLOWED IN SERVICE LATERAL SECTIONS INSERTED THROUGH BORED HOLE, UNLESS APPROVED BY LBWD ENGINEERING THROUGH VISUAL INSPECTION OR ACCEPTABLE LEAK TESTING.
3. SERVICE TAP SHALL BE IN-LINE WITH METER BOX UNLESS APPROVED BY LBWD ENGINEERING.
4. AFTER INSTALLATION OF SERVICE TAP, WRAP CONNECTION FULLY WITH POLYWRAP AND TAPE.

**SERVICE SYMBOL DESIGNATION**

NEW SERVICE INSTALLATION:

Ⓢ (2) 2" CL

**3-INCH SERVICE INSTALLATION**

**WDS - 002**



**Long Beach Water**  
Exceptional Water • Exceptional Service

RECOMMENDED

*Jimmy Huang - Uy*  
MANAGER OF ENGINEERING

APPROVED

*Robert Johnson*  
DIRECTOR OF ENGINEERING

DATE: 09-2020

SCALE: N.T.S.

SHEET 1 OF 1