


PLAN

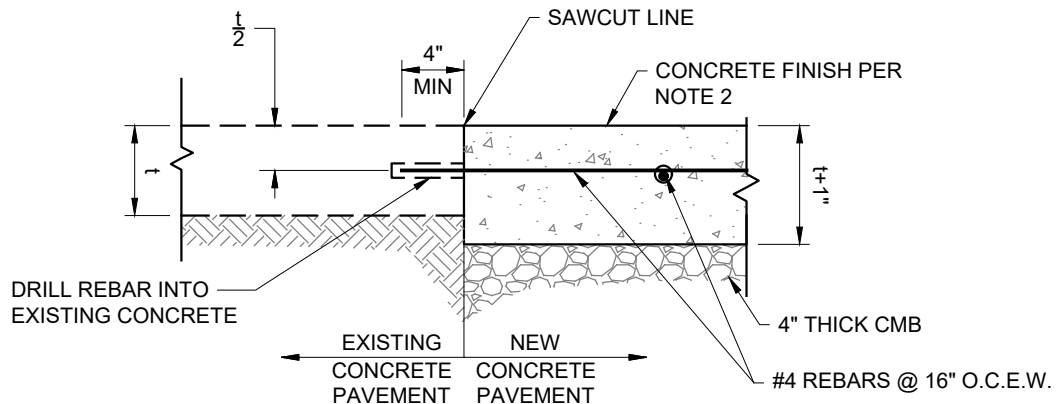

SECTION

NOTES:

1. CONCRETE SHALL BE CLASS 520-A-2500.
2. NEW CONCRETE SHALL MATCH EXISTING CONCRETE FINISH.
3. IF DISTANCE TO NEAREST CONSTRUCTION JOINT IS LESS THAN 24-INCHES, REMOVE AND REPLACE CONCRETE TO THE EXISTING JOINT.
4. IF CONDITION OF EXISTING CONCRETE PRECLUDES DRILLING NEW DOWELS, THE CONCRETE PAVEMENT REPLACEMENT SHALL BE APPROXIMATELY 4' X 5' AROUND METER BOX. PRIOR TO SAWCUTTING, CONTRACTOR SHALL DISCUSS EXISTING CONCRETE CONDITION WITH LBWD.
5. SAWCUT OVERCUTS SHALL BE NO LONGER THAN 4", AND SEALED WITH POLYFLEX CA TYPE 3 OR APPROVED EQUAL AS LISTED UNDER THE CALTRANS DIVISION OF MAINTENANCE TYPE 3 CRACK TREATMENT.

CONCRETE PAVEMENT RECONSTRUCTION AROUND METER BOXES

WDS - 132



Long Beach Water
Exceptional Water • Exceptional Service

RECOMMENDED

Jinny Huang Uy
MANAGER OF ENGINEERING

APPROVED

Robert Johnson
DIRECTOR OF ENGINEERING

DATE: 01-2021

SCALE: N.T.S.

SHEET 1 OF 1